



Electrical Distributors Co.
 KNOWLEDGE • SERVICE • INVENTORY
 ESTABLISHED 1948

Visit Us On The Web At: www.electdist.com

SAN JOSE 95126
 1135 AUZERAIS STREET
 408-293-5818
 FAX: 408-287-1152

GILROY 95020
 7120 ALEXANDER STREET
 408-847-2222
 FAX: 408-847-2324
 From Santa Cruz: 408-426-6464

SALINAS 93901
 7 WORK CIRCLE
 831-422-4786
 FAX: 831-422-4846

MONTEREY 93940
 2320 DEL MONTE AVE., #B
 831-373-4786
 FAX: 831-373-8430



A fully reconditioned power circuit breaker ready to ship back to the customer with full C5 RECONDITIONED certification and test documentation.



Photos show various components and parts that have been fully cleaned and repaired or re-plated.

The **SQUARE D C₅ RECONDITIONED** Program

Checking, Cleaning, Correcting, Calibrating and Certifying


C₅ reconditioning provides the industry's most comprehensive refurbishment and reconditioning for low and medium voltage power circuit breakers. All major brands of equipment are covered under this program.

No matter what brand of circuit breaker that you have installed, the effects of aging and years of continuous operation will begin to degrade the reliability. Leading causes of equipment failure:

- Mechanical failure of mechanism (60% of all failures)
- Aged lubrication or lack of lubrication
- Oxidation of plated components
- Worn, pitted contacts
- Antiquated and dysfunctional protective devices

During the reconditioning process, circuit breaker protective devices can also be upgraded with solid mate, RMS sensing technology.

This program provides a comprehensive scope of work that ends with a complete refurbishment and thorough testing!

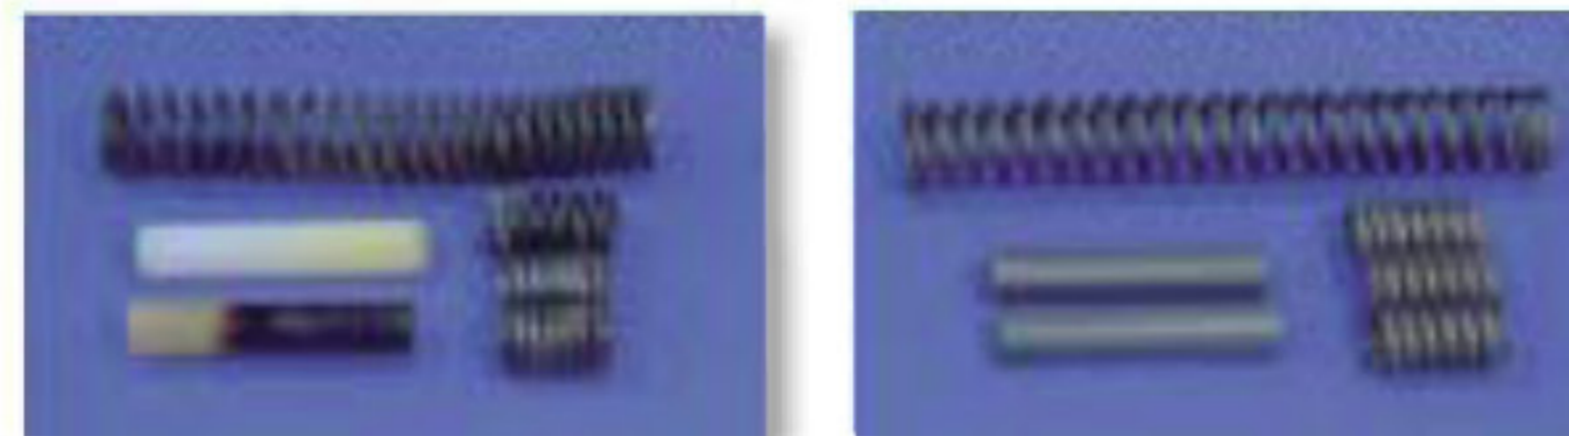

Damaged and worn parts are completely replaced with new parts.



Reconditioned low-voltage circuit breakers from various original equipment manufacturers.



A damaged circuit breaker contact assembly shown on left with fully refurbished contact assembly on the right, after being cleaned and repaired.